

## CLASSIFICATION REPORT No. 14 - A - 178 - Version 5

In accordance with standards EN 1366-10: 2022 + A1: 2024 and EN 12101-8: 2011 and EN 13501-4: 2016

### Laboratory assessment reference

- 14 - A - 178 - Version 7

### Concerning

A range of hinged door type smoke control dampers, KAMOUFLAGE type, installed on a vertical smoke extraction duct:

- Commercial reference of duct:
  - PROMATECT L 500 th = 30 / 40 / 50 mm
  - GEOFLAM th = 30 / 35/ 45 mm
  - GEOFLAM LIGHT th = 35 mm
  - TECNIVER th = 35 / 45 / 50 mm
  - GLASROC F/V500 th = 35 / 50 mm
  - EXTHAMAT P th = 25 / 30 / 35 / 45 mm
  - DESENFIRE 25HD / 25THD / 35HD / 25STR
  - GEOTEC® S th = 30 / 45 mm
  - GEOFLAM N e = 35 mm
  - Fireboard CS D5 e = 35 mm
- Commercial reference of damper:
  - KAMOUFLAGE 1V/2V 60/120
  - KAMOUFLAGE H 1V/2V 60
  - KAMOUFLAGE DP 1V 60/120

### Applicant

RF TECHNOLOGIES  
Lange Ambachtstraat 40  
B – 9860 OOSTERZELE  
  
BCE 0427.205.519

**This report annuls and replaces classification report No. 14 - A - 178 - Version 4.**

*DISCLAIMER: The current document is a translation of the corresponding and official French version. In all situations where the meaning of the current document is unclear or ambiguous, the French document should be used for purposes of disambiguation.*

**DOCUMENT FOLLOW-UP**

Version	Modification	Comment	Date		
0	<ul style="list-style-type: none"> <li>- Installation of dampers in prefabricated concrete ducts th = 75 mm</li> <li>- Implementation of the decorative plaster panel of a corridor or a wall in front of the sleeve of the dampers</li> <li>- Installation of dampers in a duct whose widths are adapted to the dimensions of the damper</li> <li>- Assembly of dampers in ducts type GEOTEC® S (GEOSTAFF) of thickness 30 mm and 45 mm</li> <li>- Integration of RC KAMOUFLAGE H</li> <li>- Validation of ATOUT option</li> <li>- Merge of classification reports Nos. 14 - A - 178 A - Version 1 and 14 - A - 178 B - Version 1</li> </ul>	/	24/11/2016	Editor	C. Schneller
				Verifier	M. Fenucci
				Approver	M. Fenucci
1	<ul style="list-style-type: none"> <li>- Installation of dampers on ducts of EXTHAMAT P th = 35 / 45 mm (EXTHA) of thickness 35 mm and 45 mm</li> <li>- Modification to additional loads on the door</li> </ul>		23/05/2017	Editor	R. Stouvenot
				Verifier	M. Fenucci
				Approver	M. Fenucci
2	Modifications to direct scope of application		14/03/2018	Editor	R. Stouvenot
				Verifier	M. Fenucci
				Approver	M. Fenucci
3	<ul style="list-style-type: none"> <li>- Installation of dampers in ducts of EI90 performance</li> <li>- Change to seal</li> <li>- Modification of sub-frame</li> </ul>		14/02/2019	Editor	C. Schneller
				Verifier	M. Fenucci
				Approver	M. Fenucci
4	<ul style="list-style-type: none"> <li>- Cold seal adding: VAME-D217</li> <li>- Installation of dampers on ducts of DESENFIRE 25 STR (MF INDUSTRIES), th = 25 mm.</li> </ul>	/	16/01/2020	Editor	R. Stouvenot
				Verifier	R. Chiva
				Approver	R. Chiva
5	<ul style="list-style-type: none"> <li>- Addition of BE number</li> <li>- Installation of dampers in GEOFLAM N ducts</li> <li>- Installation of dampers in Fireboard CS D5-35 ducts</li> <li>- Removal of installation in prefabricated concrete ducts regarding the revision of the standard EN 1366-10: 2022 + A1: 2024</li> </ul>	/	27/11/2025	Editor	C. Salsi
				Verifier	R. Stouvenot
				Approver	R. Stouvenot

## 1. INTRODUCTION

---

The classification report defines the classification assigned to the KAMOUFLAGE type smoke damper in accordance with the operating procedures given in standard EN 13501-4: 2016 "Fire classification of construction products and building elements - Part 4: Classifications from the fire resistance test data on the products used in the smoke extraction systems: ducts and smoke control dampers and in the standard EN 12101-8 "Smoke control dampers" and in the standard EN 1366-10: 2022 + A1: 2024 "Fire resistance tests for service installations – Part 10: Smoke control dampers".

## 2. ORGANISATION

---

EFFECTIS France  
Espace Technologique Bâtiment Explorer  
Route de l'Orme des Merisiers  
91190 SAINT-AUBIN | France

Notified body: 1812

## 3. APPLICANT

---

RF TECHNOLOGIES  
Lange Ambachtstraat 40  
B – 9860 OOSTERZELE

## 4. REFERENCE DOCUMENTS

---

11 - E - 554	(EFFECTIS France)	15463A	(WFRG)
11 - E - 655	(EFFECTIS France)	EFR-15-G-003599	(EFFECTIS France)
12 - U - 321	(EFFECTIS France)	EFR-16-G-000333b	(EFFECTIS France)
13 - H - 023	(EFFECTIS France)	EFR-16-T-002262	(EFFECTIS France)
15364A	(WFRG)	EFR-18-T-000270	(EFFECTIS France)
15392A	(WFRG)	EFR-18-T-000496	(EFFECTIS France)
12 - E - 440	(EFFECTIS France)	EFR-23-000381	(EFFECTIS France)
12 - E - 468	(EFFECTIS France)	EFR-24-003461	(EFFECTIS France)
15511A	(WFRG)	EFR-24-003452	(EFFECTIS France)

## 5. REFERENCE AND ORIGIN OF THE ELEMENTS EXAMINED

---

Reference: KAMOUFLAGE 1V/2V 60/120  
KAMOUFLAGE DP 1V 60/120  
KAMOUFLAGE H 1V/2V 60

Source: RF TECHNOLOGIES  
Lange Ambachtstraat 40  
B – 9860 OOSTERZELE

## 6. PRINCIPLE OF ASSEMBLY

---

### 6.1. TYPE OF FUNCTION

KAMOUFLAGE (H) 1V or 2V type dampers are defined as "smoke control dampers".

Their function is to resist fire, as specified by the fire resistance performance characteristics given in section 5 of standard EN 13501-4.

### 6.2. GENERAL

The elements tested are a range of smoke control dampers fitted in a vertical smoke extraction duct. The KAMOUFLAGE H range is identical in all respects to the KAMOUFLAGE 1V/2V range. It is intended for residential housing blocks.

The smoke control dampers, with one or two pivoting doors, are constructed as follows:

- a tunnel with frame,
- one or two doors,
- a control mechanism.

Each damper has flush-mount measurements of between:

- 300 x 385 to 700 x 1075 mm (l x h) for dampers with one door,
- 350 x 385 to 1100 x 1105 mm (l x h) for dampers with two doors.
- Free passage: for KAMOUFLAGE 1V: (W -26) x (H-26) mm,  
for KAMOUFLAGE 2V: (W -26) x (H -26) mm.

The smoke control duct is as described in procès-verbaux:

- no. 08 - A - 380 and comprises panels 30, 40 or 50 mm thick for panels in PROMATECT L500,
- no. 10 - A - 067 - Version 2 and comprises panels 30, 35 or 45 mm thick for panels in GEOFLAM F,
- no. 13 - A - 895 and comprises 35 mm thick panels in GEOFLAM LIGHT,
- no. 08 - A - 462 - Version 2, 08-A-115 Version 1 and 13-A-1041 and comprises panels 35, 45 or 50 mm for panels in TECNIVER,
- no. EFR-16-001013-Version 1 and comprises 30 mm thick panels in GEOTEC® S,
- no. EFR-16-001960 and comprises 30 mm thick panels in GEOTEC® S,
- no. EFR-16-002203 and comprises 45 mm thick panels in GEOTEC® S,
- no. EFR-16-002205 and comprises 45 mm thick panels in GEOTEC® S,
- no. EFR 15-001253Version 1 and comprises 25 mm thick panels for panels in DESENFIRE HD 25,
- no. EFR-15-001255 - Version 1 and comprises 25 mm thick panels for panels in DESENFIRE THD 25,
- no. EFR-15-000723 - Version 1 and comprises 35 mm thick panels for panels in DESENFIRE THD 35,
- no. EFR-16-003582 and comprises 25 mm thick panels for panels in DESENFIRE STR 25,
- no. EFR-15-000198 and comprises 35 mm thick panels for panels in GLASROC F V500/35,
- no. EFR-15-000201 and comprises 50 mm thick panels for panels in GLASROC F V500/50,
- no. EFR-16-001070 and comprises 25 mm thick panels for panels in EXTHAMAT,
- no. 13 - A - 032 and comprises 30 mm thick panels for panels in EXTHAMAT,
- no. 13 - A - 049 and comprises 35 mm thick panels for panels in EXTHAMAT,
- no. EFR-24-003452 and comprises 35 mm thick panels for panels in GEOFLAM N,
- no. EFR-24-003461 and comprises 35 mm thick panels for panels in Fireboard CS D5-35.

### 6.3. DETAILED DESCRIPTION OF ELEMENTS

#### 6.3.1. KAMOUFLAGE (H) 1V smoke control dampers

##### 6.3.1.1. Door

The door is formed of an assembly of two panels and support sections (two vertical, one horizontal) in galvanised steel 1.25 mm thick:

- one panel on the side facing the fire, in refractory of type Promatect H 15 mm thick or IGNIBOARD (manufacturer Keen Eagle) 15 mm thick, and of bulk density 900 kg/m<sup>3</sup>,
- one plasterboard panel 9.5 mm thick (GKB A10, KNAUF) on the side away from the fire.

The three sections are located between the two panels:

- the vertical support profiles are U-shaped, with dimensions 47.5 x 29.3 mm,
- the horizontal profile is C-shaped, with dimensions 69.5 x 47.5 mm.

These three sections are fixed to the Promatect H panel with four steel rivets Ø 4.8 mm, and to the plasterboard panel with steel screws Ø 3.5 mm (number of screws = height of the plasterboard panel/200 mm, round top). The screws are spaced at uniform intervals the height of the panel.

##### 6.3.1.2. Damper tunnel

The tunnel is formed of a framework in extruded aluminium profiles 60 x 64 mm, assembled using Zamak connectors.

Inside, each profile is fitted along its length with a refractory panel in Promatect H of section 10 x 81 mm (th x l) fixed with steel rivets Ø 4.8 mm at 420 mm intervals.

For the KAMOUFLAGE DP there is also an L-shaped steel cross-profile, 3 mm in thickness and of dimensions 20 x 50 mm, fixed within the tunnel by 4 steel screws diameter 4.2 mm. The cross-profile is covered by a 56 mm wide, 1.5 mm thick aluminium profile

##### 6.3.1.3. Sealing

Cold sealing is provided by:

- a profiled rubber seal 7.3 x 23 mm or profiled rubber seal VA-D217 17.6 x 7.3 mm (w x th) (ref. VA-D212 section 20.5 x 7.3 mm for KAMOUFLAGE DP) crimped into the extruded tunnel profile,

Or

- a profiled silicone seal 14.7 x 14.4 mm reference VAME-D217 crimped into the extruded tunnel profile.

Hot sealing is provided by an RFT EX-539P type intumescent seal or "Rectorseal Blaseseal" type seal (manufactured by Rectorseal) 15 x 2 mm, retained in the Promatect door panel using steel clips 8 x 12 mm (w x h) at 30 mm intervals.

##### 6.3.1.4. Hinging

The door hinges on two 1.25 mm thick sheet steel hinges, having a Ø 5 mm rotating shaft, that are fixed to the door by two M5 steel bolts and nuts, and to the tunnel with three steel rivets Ø 4.8 mm.

For standard KAMOUFLAGE: The two hinges are equipped with compression springs, allowing the door to open.

#### 6.3.1.5. Mechanism

##### **For standard KAMOUFLAGE:**

The doors are held in the closed position by an Rf-T VAL type lock, consisting of three parts in Zamak, three springs, two parts in galvanised steel, a lock and a counter-panel.

The lock is fitted into the horizontal support profile using Ø 5 mm steel screws.

Manual operation is by means of a steel key.

Electrical operation is achieved by demagnetisation of the lock.

The door is retained in an open position by an arm in 2 mm thick folded sheet steel rotating around a Ø 5 mm shaft fixed to the vertical aluminium profile on the hinge side. The arm is guided in a plastic part fixed in the horizontal support section.

In the open position a door spring fitted in the arm pushes the arm into an opening in the support profile.

The position of the door is detected with two position sensors of Crouzet V4 or Keen Eagle type, installed in a plastic part held in the horizontal support profile.

The position sensors and lock are connected with an Atem euro connector block, fitted in a connecting unit that is snapped into the aluminium section on the hinge side.

##### **For KAMOUFLAGE DP:**

Retention of the doors in the closed position is by an Rf-T "VAL-ME" type lock, consisting of three parts in Zamak, three springs, two parts in galvanised steel, a lock and a counter-panel.

The lock is fitted into the horizontal support profile using Ø 5 mm steel screws.

Manual operation is by means of a steel key.

Electrical release is by electrical demagnetising of the lock, controlled by the motor's printed circuit.

#### 6.3.1.6. Position detection of the KAMOUFLAGE DP

A 2 mm thick folded sheet steel arm is fixed onto the frame's vertical aluminium profile, rotating about a Ø 5 mm shaft. The arm is guided by a plastic component fixed within the blade's horizontal support.

The position of the blade is detected via two position contacts of type Crouzet V4 or Keen Eagle, installed in a plastic component retained within the horizontal support profile and actuated by the arm.

#### 6.3.1.7. Motor for KAMOUFLAGE DP

The blade is opened and closed by an electric motor of type VAMEUK-ME (Aum Mueller DD90 / 24VDC). The motor is attached to the blade with a stainless steel profile of overall dimensions 165 x 47 x 48 x 3 mm and 3 steel M5 screws.

A 4 mm thick steel operating lever 155 mm in length is bolted onto the motor's shaft by a 10 mm long M6 diameter steel bolt. A steel actuator spindle and 10 mm diameter roller 12 mm in length are mounted on the arm. The roller is guided in a slot in the cross-profile. Rotation of the motor opens or closes the blade. Stoppage of the blade is provided by stoppage of the lever in the slot in the cross-profile

### 6.3.2. KAMOUFLAGE (H) 2V smoke control dampers

#### 6.3.2.1. Doors

The doors are produced by assembly of two panels and support sections (two vertical, one horizontal) in 1.25 mm thick galvanised steel:

- one panel on the side facing the fire, in refractory of type Promatect H 15 mm thick or IGNIBOARD (manufacturer Keen Eagle) 15 mm thick, and of bulk density 900 kg/m<sup>3</sup>,
- one plasterboard panel 9.5 mm thick (GKB A10, KNAUF) on the side away from the fire.

The three sections are located between the two panels:

- the vertical support profiles are U-shaped, with dimensions 47.5 x 29.3 mm,
- the horizontal profile is C-shaped, with dimensions 69.5 x 47.5 mm.

These three sections are fixed to the Promatect H panel with four steel rivets Ø 4.8 mm, and to the plasterboard panel with steel screws Ø 3.5 mm (number of screws = height of the plasterboard panel/200 mm, round top). The screws are spaced at uniform intervals the height of the panel.

#### 6.3.2.2. Damper tunnel

The tunnel is formed of a framework in extruded aluminium profiles 60 x 64 mm, assembled using Zamak connectors.

Inside, each profile is fitted along its length with a refractory panel in Promatect H of section 10 x 81 mm (th x l) fixed with steel rivets Ø 4.8 mm at 420 mm intervals.

#### 6.3.2.3. Sealing

Cold sealing is provided by:

- a profiled rubber seal 7.3 x 23 mm or profiled rubber seal VA-D217-B 17.6 x 7.3 mm (w x th) (except for KAMOUFLAGE DP) crimped into the extruded tunnel profile,

Or

- a profiled silicone seal 14.7 x 14.4 mm reference VAME-D217 crimped into the extruded tunnel profile.

Hot sealing is provided by an RFT EX-539P type intumescent seal or "Rectorseal Blaseseal" type seal (manufactured by Rectorseal) 15 x 2 mm, retained in the Promatect door panel using steel clips 8 x 12 mm (w x h) at 30 mm intervals.

#### 6.3.2.4. Holding in open position

The doors are retained in an open position by an arm in 2 mm thick folded sheet steel rotating around a shaft fixed to the vertical aluminium profile on the hinge side. The arm is guided in a plastic part fixed in the horizontal support section. In the open position a torsion spring fitted in the arm pushes the arm into an opening in the support profile.

#### 6.3.2.5. Hinging

Each door hinges on two 1.25 mm thick sheet steel hinges, having a Ø 5 mm rotating shaft, that are fixed to the door by two M5 steel bolts and nuts, and to the tunnel with three steel rivets Ø 4.8 mm. The two hinges are fitted with compression springs allowing the door to open.

#### 6.3.2.6. Mechanism

The doors are held in the closed position by an Rf-T "VAL" type lock, consisting of three parts in Zamak, three springs, two parts in galvanised steel, a lock and a counter-panel.

The lock is fitted into one of the two doors in the horizontal support profile using Ø 5 mm steel screws. The door without lock is retained in a closed position by the door with the lock, by means of an extension to the support section.

Manual operation is by means of a steel key.

Electrical operation is achieved by demagnetisation of the lock.

The position of the door is detected with two position sensors of Crouzet V4 or Keen Eagle type, installed in a plastic part held in the horizontal support profile.

The position sensors and lock are connected with an Atem euro connector block, fitted in a connecting unit that is snapped into the aluminium section on the hinge side.

In the open position, sliding of the torsion spring allows the door to close.

#### 6.3.3. Options

- **For painting the damper doors:**

The KAMOUFLAGE damper doors may be coated with a layer of paint on the unexposed side.

- **KAMOUFLAGE ATOUT option:**

It is possible to pre-fit an aluminium panel maximum thickness 0.8 mm or a steel panel maximum thickness 0.5 mm in the door of the dampers.

This panel is attached to the door by a 60 mm wide double-sided adhesive strip uniformly applied over the surface of the panel on the side away from the fire.

- **Painting of the damper frame:**

The frame to receive the KAMOUFLAGE type dampers may be coated with a layer of paint on the unexposed side.

- **Application of wallpaper onto the damper slat:**

The KAMOUFLAGE type damper doors may be covered with one layer of wallpaper glued to them.

- **Installation of a fall arrest bar (KGD type):**

The frame of the KAMOUFLAGE type dampers may be pre-fitted with two or four aluminium fall arrest bars 20 x 2 mm. These bars are fixed into the frame of the dampers by steel hook screws Ø 1.5 mm.

- **Application of an aluminium film onto the exposed side of the plasterboard door panel:**

30 µm thick aluminium film may be glued to the exposed side of the plasterboard panel that forms the damper door.

- **Mounting of dampers using a sub-frame (type EASY-KAP) or sub-frame with foldable anti-fall grill (type EASY-KGC 1V/2V):**

An EASY-KAP/EASY-KGC sub-frame may be installed on the duct to accept the damper.

Fixing of the sub-frame to the duct is provided by four screws Ø 6 x th duct mm.

Fixing of the damper to the sub-frame is by four steel bolts M3.5 x 32 mm.



- **Application of mastic in the angle formed by the damper frame and surface of the duct:**

The space between the frame section and the surface of the duct may be filled with acrylic mastic to provide a uniform finish at the joint between frame and wall.

- **Addition of a supplementary panel to the door of the dampers:**

It is possible to add to the plasterboard panel and/or to the damper's aluminium tunnel a 3<sup>rd</sup> skin of a material having the following properties:

- Fire reaction classification of material forming the panel: M1.

This 3<sup>rd</sup> panel is either glued or screwed to the plasterboard panel.

Where this panel is added the maximum permitted excess surface weight for each size, in order that the total weight does not exceed the weight of the door of the largest damper in the range is shown in the following tables:

The excess surface weight is expressed in the tables in kg/door.

- For the 1V range:

Poids suppl. sur le vantail en kg										
kg		L								
1V KAM		300	350	400	450	500	550	600	650	700
H	385	10,66	8,29	6,41	4,86	3,54	2,35	1,32	0,66	0,72
	415	11,52	8,97	6,94	5,27	3,85	2,57	1,47	0,73	0,80
	445	12,38	9,64	7,47	5,68	4,16	2,78	1,60	0,80	0,87
	475	12,78	10,36	8,05	6,14	4,51	3,05	1,79	0,86	0,94
	505	12,55	11,04	8,57	6,54	4,82	3,27	1,92	0,93	1,01
	535	12,36	11,74	9,13	6,98	5,15	3,51	2,08	0,99	1,08
	565	12,14	11,56	9,65	7,38	5,45	3,72	2,22	1,06	1,15
	595	11,96	11,36	10,23	7,84	5,81	3,99	2,41	1,13	1,23
	625	11,81	11,17	10,54	8,31	6,18	4,27	2,61	1,19	1,30
	655	11,66	10,99	10,33	8,79	6,56	4,56	2,82	1,26	1,37
	685	11,44	10,74	10,04	9,20	6,86	4,77	2,95	1,32	1,44
	715	11,22	10,49	9,76	9,04	7,17	4,99	3,09	1,39	1,51
	745	11,00	10,24	9,48	8,72	7,47	5,20	3,23	1,46	1,59
	775	10,85	10,06	9,27	8,48	7,70	5,49	3,44	1,57	1,66
	805	10,63	9,81	8,99	8,17	7,35	5,71	3,57	1,64	1,73
	835	10,41	9,56	8,71	7,86	7,01	5,93	3,71	1,71	1,80
	865	10,19	9,31	8,43	7,55	6,67	5,74	3,85	1,77	1,87
	895	10,04	9,13	8,22	7,31	6,40	5,44	4,05	1,91	1,94
	925	9,81	8,87	7,93	6,99	6,05	5,07	4,13	1,97	2,02
	955	9,60	8,63	7,65	6,68	5,71	4,70	3,73	2,04	2,09
	985	9,37	8,37	7,37	6,37	5,37	4,32	3,32	2,10	2,16
	1015	9,22	8,19	7,16	6,13	5,10	4,02	2,99	2,05	2,23
	1045	9,00	7,94	6,88	5,82	4,76	3,65	2,59	2,12	2,30
	1075	8,78	7,69	6,60	5,51	4,42	3,28	2,18	2,18	2,49

- For the 2V range:

		Poids suppl. sur le vantail en kg															
	kg/door	L															
	2V KAM	350	400	450	500	550	600	650	700	750	800	850	900	950	1000	1050	1100
<b>H</b>	385	11,75	11,53	11,30	11,13	10,91	10,69	9,57	8,43	7,47	6,56	5,72	5,01	4,30	3,69	3,08	2,54
	415	11,60	11,36	11,12	10,93	10,70	10,46	10,27	9,10	8,06	7,08	6,18	5,41	4,65	3,99	3,33	2,75
	445	11,45	11,19	10,93	10,73	10,48	10,23	10,03	9,77	8,65	7,60	6,64	5,81	4,99	4,29	3,58	2,96
	475	11,34	11,07	10,79	10,58	10,32	10,05	9,83	9,57	9,28	8,16	7,14	6,25	5,39	4,63	3,88	3,21
	505	11,20	10,92	10,62	10,39	10,11	9,83	9,60	9,32	9,08	8,69	7,61	6,67	5,75	4,94	4,14	3,43
	535	11,06	10,76	10,45	10,20	9,91	9,61	9,37	9,07	8,82	8,52	8,08	7,08	6,10	5,25	4,40	3,65
	565	10,91	10,60	10,28	10,01	9,71	9,40	9,13	8,82	8,56	8,25	7,94	7,49	6,46	5,56	4,66	3,87
	595	10,81	10,48	10,14	9,86	9,54	9,21	8,94	8,61	8,33	8,00	7,68	7,40	6,86	5,90	4,96	4,13
	625	10,65	10,31	9,96	9,66	9,35	9,01	8,71	8,37	8,07	7,73	7,39	7,10	6,76	6,22	5,23	4,35
	655	10,51	10,15	9,77	9,46	9,18	8,82	8,51	8,15	7,84	7,49	7,13	6,82	6,46	6,15	5,53	4,61
	685	10,37	10,00	9,61	9,29	8,99	8,62	8,29	7,92	7,60	7,22	6,85	6,53	6,15	5,83	5,46	4,84
	715	10,27	9,88	9,48	9,14	8,78	8,39	8,05	7,66	7,32	6,93	6,55	6,21	5,82	5,48	5,09	4,75
	745	10,11	9,71	9,29	8,94	8,56	8,16	7,80	7,40	7,04	6,64	6,24	5,88	5,48	5,13	4,72	4,37
	775	9,97	9,55	9,12	8,75	8,40	7,99	7,62	7,20	6,83	6,41	5,99	5,62	5,20	4,83	4,42	4,05
	805	9,83	9,39	8,95	8,56	8,20	7,77	7,38	6,95	6,57	6,13	5,70	5,31	4,88	4,50	4,06	3,68
	835	9,72	9,27	8,81	8,41	7,99	7,54	7,14	6,69	6,29	5,84	5,39	4,99	4,54	4,14	3,70	3,30
	865	9,57	9,10	8,62	8,21	7,77	7,31	6,89	6,43	6,01	5,55	5,09	4,67	4,21	3,79	3,33	2,91
	895	9,42	8,94	8,45	8,02	7,62	7,14	6,71	6,23	5,80	5,32	4,84	4,41	3,93	3,50	3,02	2,59
	925	9,28	8,79	8,28	7,83	7,41	6,92	6,47	5,98	5,53	5,04	4,55	4,10	3,61	3,16	2,67	2,22
	955	9,18	8,67	8,14	7,68	7,20	6,69	6,23	5,72	5,26	4,75	4,24	3,78	3,27	2,81	2,30	1,84
	985	9,02	8,50	7,96	7,48	6,98	6,46	5,98	5,46	4,98	4,46	3,93	3,46	2,93	2,46	1,93	1,76
	1015	8,88	8,34	7,79	7,29	6,83	6,29	5,80	5,26	4,77	4,23	3,69	3,19	2,66	2,16	1,73	1,82
	1045	8,74	8,18	7,62	7,11	6,63	6,07	5,57	5,01	4,50	3,95	3,39	2,89	2,33	1,83	1,78	1,88
	1075	8,63	8,06	7,48	6,96	6,41	5,84	5,32	4,75	4,23	3,66	3,09	2,57	2,00	1,74	1,84	1,94
	1105	8,48	7,89	7,29	6,76	6,20	5,61	5,07	4,49	3,95	3,37	2,78	2,24	1,69	1,79	1,89	2,00

The two tables above take into account, the excess weight produced by the addition of a panel such as that described in the ATOUT version.

## 7. INSTALLATION OF TESTED ELEMENTS

### 7.1. FOR A DUCT IN PROMATECT, GEOFLAM, GEOFLAM LIGHT, TECNIVER, EXTHAMAT P, GLASROC, DESENFIRE, GEOTEC® S, GEOFLAM N OR FIREBOARD CS D5-35


For the installation of each damper an opening is made on one face of the duct:

- For installation with sub-frame (type EASY-KAP/EASY-KCG):
  - o a cut-out of dimensions  $(W + 2 \times \text{duct thickness} + 20) \times (H + 2 \times \text{duct thickness} + 20)$  mm,
- For installation without sub-frame:
  - o of dimensions  $(W + 2 \times \text{duct thickness} + 10) \times (H + 2 \times \text{duct thickness} + 10)$  mm.

The cut-out for the damper is then strengthened with a sleeve of plasterboard panels of the same type as those used for the duct, having a total depth of 105 mm.

The dampers are fixed to the duct by sleeves. This sleeve may be affixed independently:

- Within the duct,
- In the axis of the duct,
- On the outside of the duct,
- Offset from the duct (in an off-duct).

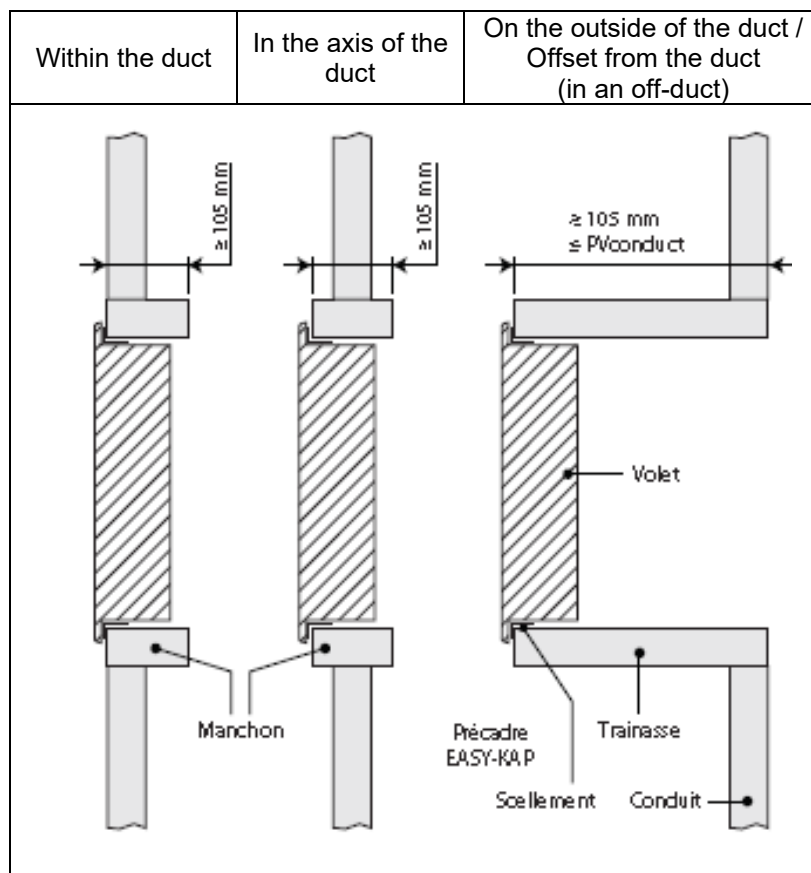

Finally, for installation of each damper:

- For installation with sub-frame (type EASY-KAP/EASY-KCG):
  - o the damper is installed into the sub-frame and mounted onto the latter with four VBA steel screws  $\varnothing 6 \times \text{duct thickness}$  mm.
- For installation without sub-frame:
  - o the damper is installed into the duct and fixed to the latter with four steel screws  $\varnothing 6 \times 40$  mm.

#### 7.1.1. Installation on PROMATECT L500 type duct

The sleeve comprises two cross-pieces and two uprights, also made of PROMATECT L500 of the same thickness as that of the duct itself (30, 40 or 50 mm), fixed together and to the wall.

Where installation is with a sub-frame the openings are first coated with Promacol S, then the sub-frame is fixed to the sleeve with VBA 6 x 30, 40 or 50 mm screws and finished with PROMACOL S, thus reducing the free dimension of the opening to  $(W + 10) \times (H + 10)$  mm.

#### 7.1.2. Installation on Fireboard CS D5-35 type duct

The sleeve comprises two cross-pieces and two uprights, also made of Fireboard CS D5 of thickness 35 mm. They are fixed together and to the wall with wood screws  $\varnothing 4 \times 70$  mm at max. 155 mm centres and glue of reference Fireboard CS Glue GT1 (KNAUF).

Where installation is with a sub-frame the openings are first coated with Fireboard CS Glue GT1, then the sub-frame is fixed to the sleeve, thus reducing the free dimension of the opening to  $(W + 10) \times (H + 10)$  mm.

#### 7.1.3. Installation on GEOFLAM, GEOFLAM LIGHT or GEOFLAM N type duct

The sleeve comprises two cross-pieces and two uprights, also made of GEOFLAM of the same thickness as that used for the duct (30, 35 or 45 mm), GEOFLAM LIGHT or GEOFLAM N of the same thickness as that used for the duct (35 mm).

The edges of the opening were coated with PLACOL-type (BPB) adhesive plaster before embodying the crosspieces and uprights of the sleeve into the opening

Sealing of the joints between uprights and cross-pieces and between the sleeve and the wall was achieved with vegetable fibre caulking + MOLDA plaster (DUO or NORMAL) (BPB).

Where installation is with a subframe, the subframe is caulked to the duct with vegetable fibre + MOLDA plaster (DUO or NORMAL) (BPB), reducing the free opening to dimensions  $(W + 10) \times (H + 10)$  mm.

#### 7.1.4. Installation on TECNIVER type duct

The sleeve comprises two cross-pieces and two uprights, also in TECNIVER of the same thickness as that used for the duct (35, 45 or 50 mm), glued and screwed together and to the wall using VBA  $\varnothing 5 \times 70$  mm screws at 150 mm intervals.

The sealing of the joints between uprights and cross-pieces and between the sleeve and the wall is achieved with CF GLUE®.

For installation with subframe, openings are first coated with CF GLUE®, then the sub-frame is glued to the sleeve, reducing the free opening to dimensions  $(W + 10) \times (H + 10)$  mm.

#### 7.1.5. Installation on an EXTHAMAT P duct

The sleeve comprises two cross-pieces and two uprights, also made of EXTHAMAT P of the same thickness as that used for the conduit (25, 30, 35 or 45 mm).

The edges of the opening are coated with adhesive plaster before embodying the crosspieces and uprights of the lining into the opening.

Sealing of the joints between uprights and cross-pieces and between the sleeve and the wall is achieved using vegetable fibre caulking + plaster.

Where installation is with a sub-frame, the subframe is caulked to the duct, reducing the free opening to dimensions  $(W + 10) \times (H + 10)$  mm.

#### 7.1.6. Installation on GLASROC F/V500 DUCT

The sleeve comprises four cross-pieces also made of GLASROC F V500 of the same thickness as that used for the duct (35 or 50 mm), glued and screwed together and to the wall with VBA Ø 5 x 70 mm screws, at 150 mm intervals.

Sealing of the joints between uprights and cross members and between the sleeve and the wall is achieved using GLASROC® F V500 adhesive.

For installation with subframe, openings are first coated with CF GLUE®, then the sub-frame is glued to the sleeve, reducing the free opening to dimensions  $(W + 10) \times (H + 10)$  mm.

#### 7.1.7. Installation on DESENFIRE HD / THD / STR duct

The sleeve comprises two cross-pieces and two uprights, also made of DESENFIRE of the same thickness as that used for the duct itself (25HD, 25THD, 25STR or 35HD mm).

The edges of the opening are coated with FACILIS (SEMIN)-type adhesive plaster before embodying the cross-pieces and uprights of the sleeve into the opening.

Sealing of the joints between uprights and cross-pieces and between the sleeve and the wall is achieved using vegetable fibre caulking + LAFARGE plaster.

Where installation is with a subframe, the subframe is caulked to the duct with vegetable fibre + LAFARGE plaster, reducing the free opening to dimensions  $(W + 10) \times (H + 10)$  mm.

#### 7.1.8. Installation on a GEOTEC® S duct

The sleeve comprises two cross-pieces and two uprights, also in GEOTEC® S of the same thickness as that used for the duct (30 or 45 mm), glued and caulked together and to the wall or glued and screwed together and onto the wall using VBA Ø 5 x as applicable 80 / 90 mm screws at 100 mm intervals.


The edges of the opening are coated with adhesive plaster of type GEOCOL or GEOCOL S (GEOSTAFF) before embodying the crosspieces and uprights of the sleeve into the opening.

Sealing of the joints between uprights and cross-pieces and between the sleeve and the wall is achieved with caulking or plaster tile glue GEOCOL or GEOCOL S (GEOSTAFF).

Where mounted with a sub-frame, the sub-frame is fastened to the duct by caulking or by plaster tile glue GEOCOL or GEOCOL S (GEOSTAFF) and by Ø 5 x as applicable 30 / 45 mm screws at 100 mm intervals, so reducing the free opening to dimensions  $(W + 10) \times (H + 10)$  mm.


## 7.2. FITTING OF A PASSAGE'S DECORATIVE PLASTER PANEL IN FRONT OF THE SLEEVE OR DUCT CONTAINING THE DAMPERS

The decorative plaster panel (trim) for the passage can be fitted in front of the sleeve or duct containing the dampers.

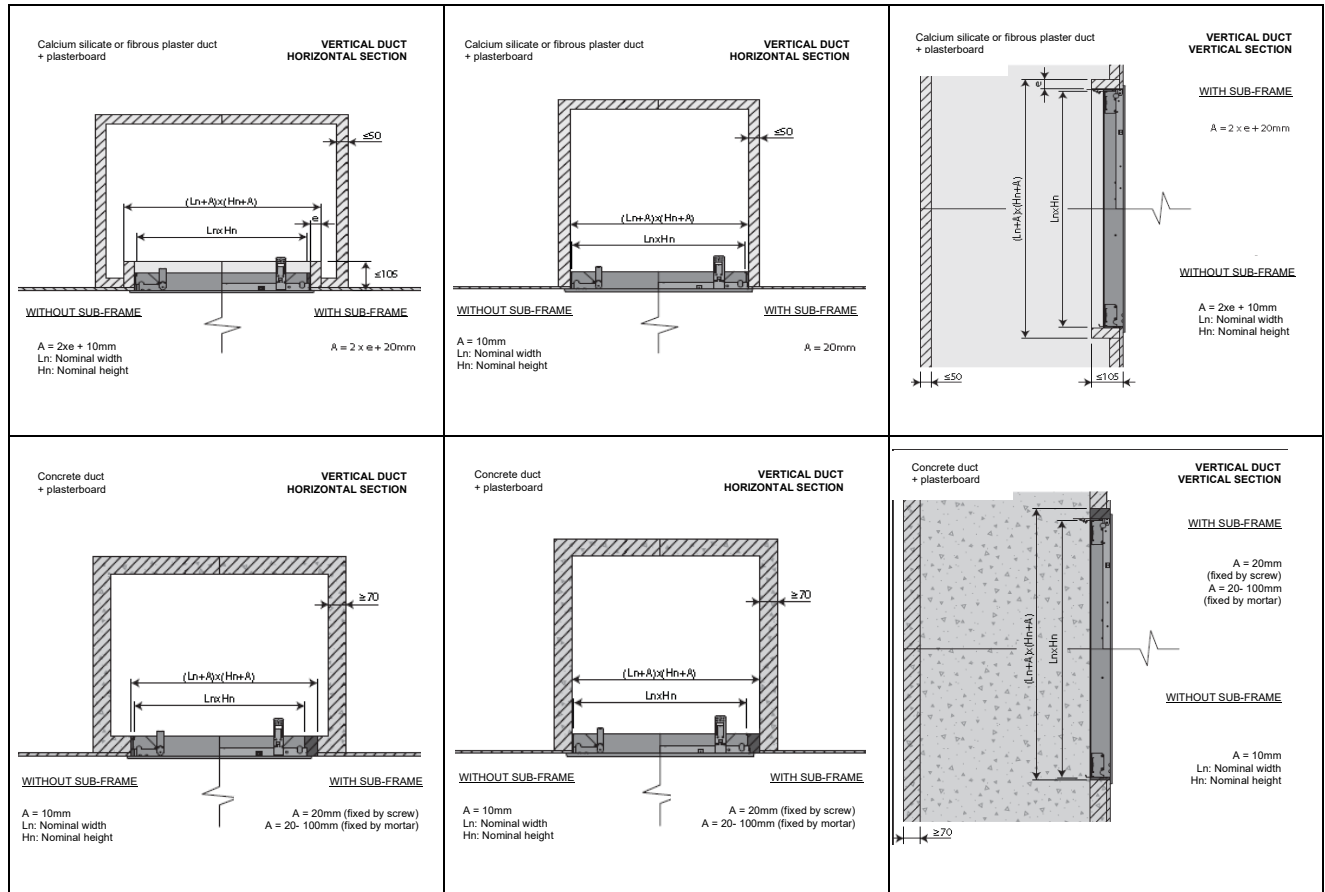

### 7.3. IMPLEMENTATION OF A WALL IN FRONT OF THE SLEEVE OR DUCT CONTAINING THE DAMPERS

A wall can be implemented in front of the sleeve or duct containing the dampers.

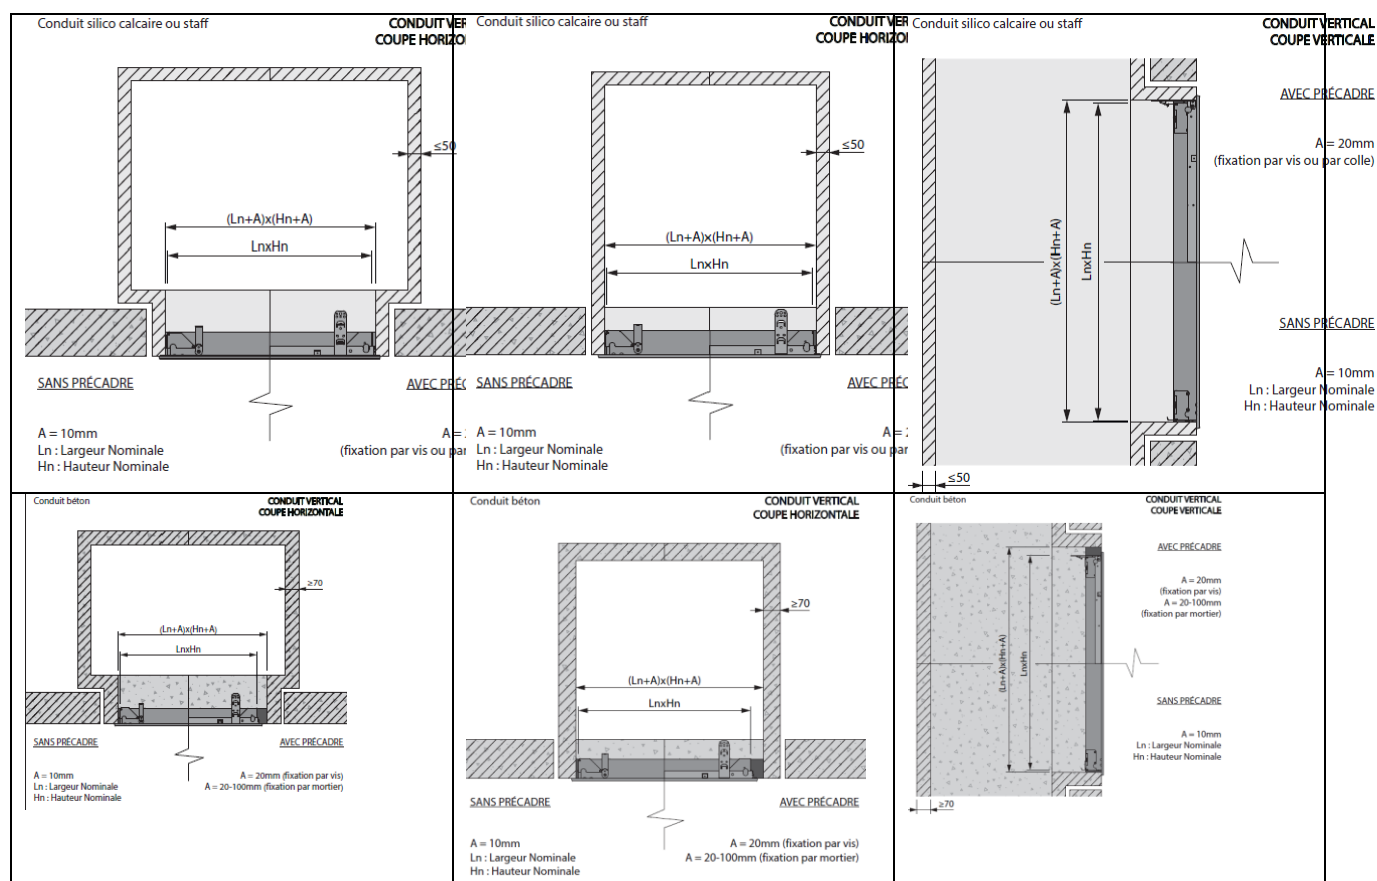

#### 7.4. INSTALLATION OF DAMPERS IN A DUCT HAVING SIZES ADAPTED TO THE DIMENSIONS OF THE DAMPER

The dampers can be installed in the ducts whose widths are adapted to the dimensions of the damper, on condition that the ducts are validated in the EFECTIS France reference classification report Efectis France n°14 - A - 178.

<p>Calcium silicate or fibrous plaster duct</p> <p><b>VERTICAL DUCT HORIZONTAL SECTION</b></p> <p>WITHOUT SUB-FRAME</p> <p>WITH SUB-FRAME</p> <p><math>A = 2e + 10\text{mm}</math> Ln: Nominal width Hn: Nominal height</p> <p><math>A = 2 \times e + 20\text{mm}</math></p>	<p>Calcium silicate or fibrous plaster duct</p> <p><b>VERTICAL DUCT HORIZONTAL SECTION</b></p> <p>WITHOUT SUB-FRAME</p> <p>WITH SUB-FRAME</p> <p><math>A = 10\text{mm}</math> Ln: Nominal width Hn: Nominal height</p> <p><math>A = 20\text{mm}</math></p>	<p>Calcium silicate or fibrous plaster duct</p> <p><b>VERTICAL DUCT VERTICAL SECTION</b></p> <p>WITH SUB-FRAME</p> <p><math>A = 2 \times e + 20\text{mm}</math></p> <p>WITHOUT SUB-FRAME</p> <p><math>A = 2e + 10\text{mm}</math> Ln: Nominal width Hn: Nominal height</p>
<p>Concrete duct</p> <p><b>VERTICAL DUCT HORIZONTAL SECTION</b></p> <p>WITHOUT SUB-FRAME</p> <p>WITH SUB-FRAME</p> <p><math>A = 10\text{mm}</math> Ln: Nominal width Hn: Nominal height</p> <p><math>A = 20\text{mm}</math> (fixed by screw) <math>A = 20\text{--}100\text{mm}</math> (fixed by mortar)</p>	<p>Concrete duct</p> <p><b>VERTICAL DUCT HORIZONTAL SECTION</b></p> <p>WITHOUT SUB-FRAME</p> <p>WITH SUB-FRAME</p> <p><math>A = 10\text{mm}</math> Ln: Nominal width Hn: Nominal height</p> <p><math>A = 20\text{mm}</math> (fixed by screw) <math>A = 20\text{--}100\text{mm}</math> (fixed by mortar)</p>	<p>Concrete duct</p> <p><b>VERTICAL DUCT VERTICAL SECTION</b></p> <p>WITH SUB-FRAME</p> <p><math>A = 20\text{mm}</math> (fixed by screw) <math>A = 20\text{--}100\text{mm}</math> (fixed by mortar)</p> <p>WITHOUT SUB-FRAME</p> <p><math>A = 10\text{mm}</math> Ln: Nominal width Hn: Nominal height</p>



## 8. FIRE RESISTANCE CLASSIFICATIONS

### 8.1. CLASSIFICATION REFERENCES

This classification procedure was performed in accordance with Section 7.3.5. of Standard EN 13501-4.

### 8.2. CLASSIFICATIONS

The elements are classified according to the following combinations of performance and class parameters.

Dampers with this classification have undergone 300 cycles unloaded.

No other classification is permitted.

#### **For dampers type KAMOUFLAGE (H) 1V/2V 60 installed in a duct:**

- in PROMATECT L500 th = 30 mm
- in GEOFLAM th = 30 mm
- in TECNIVER L35 th = 35 mm
- in GLASROC F/V500 th = 35 mm
- in GEOTEC® S th = 30 mm
- in EXTHAMAT th = 25 mm
- in DESENFIRE HD th = 25 mm
- in FIREBOARD CS D5 th = 35 mm

E	I	-	t	S	Ved	ho	i	<->	o	Operating pressure	multi	AA
<b>E</b>	<b>I</b>		<b>60</b>	<b>S</b>	<b>Ved</b>	-	<b>i</b>	<->	<b>o</b>	<b>-1500/+500 Pa</b>	<b>multi</b>	<b>AA</b>

#### **For dampers type KAMOUFLAGE DP (H) 1V 60 installed in a duct:**

- in PROMATECT L500 th = 30 mm
- in GEOFLAM th = 30 mm
- in TECNIVER L35 th = 35 mm
- in GLASROC F/V500 th = 35 mm
- in GEOTEC® S th = 30 mm
- in EXTHAMAT th = 25 mm
- in DESENFIRE HD th = 25 mm
- in FIREBOARD CS D5 th = 35 mm

E	I	-	t	S	Ved	ho	i	<->	o	Operating pressure	multi	AA
<b>E</b>	<b>I</b>		<b>60</b>	<b>S</b>	<b>Ved</b>	-	<b>i</b>	<->	<b>o</b>	<b>-500/+500 Pa</b>	<b>multi</b>	<b>AA</b>

**For dampers of KAMOUFLAGE 1V (ME) / 2V or KAMOUFLAGE H 1V / H 2V 120 type fitted with grille installed:**

- in a PROMATECT L500 duct th = 40 mm
- in a GEOFLAM duct th = 35 mm
- in an EXTHAMAT duct th = 30 mm
- in a DESENFIRE THD duct th = 25 mm
- in a TECNIVER L35 duct th = 45 mm

E	I	-	t	S	Ved	ho	i	<->	o	Operating pressure	multi	AA
<b>E</b>	<b>I</b>		<b>90</b>	<b>S</b>	<b>Ved</b>	-	<b>i</b>	<->	<b>o</b>	<b>-1500/+500 Pa</b>	<b>multi</b>	<b>AA</b>

**For dampers type KAMOUFLAGE DP 60 fitted with grille installed:**

	I	-	t	S	Ved	ho	i	<->	o	Operating pressure	multi	AA
<b>E</b>	<b>I</b>		<b>90</b>	<b>S</b>	<b>Ved</b>	-	<b>i</b>	<->	<b>o</b>	<b>-500/+500 Pa</b>	<b>multi</b>	<b>AA</b>

**For dampers type KAMOUFLAGE 1V/2V 120 installed in a duct:**

- in a PROMATECT L500 duct th = 50 mm
- in a GEOFLAM duct th = 45 mm
- in a GEOFLAM LIGHT duct th = 35 mm
- in a GEOTEC S duct th = 45 mm
- in an EXTHAMAT duct th = 35 mm
- in a DESENFIRE HD duct th = 35 mm
- in a DESENFIRE duct th = 45 mm
- in a DESENFIRE STR duct th = 25 mm
- in a TECNIVER L50 duct th = 45 mm
- in a GLASROC F/V500 duct th = 50 mm
- in a GEOFLAM N duct th = 35 mm

E	I	-	t	S	Ved	ho	i	<->	o	Operating pressure	multi	AA
<b>E</b>	<b>I</b>		<b>120</b>	<b>S</b>	<b>Ved</b>	-	<b>i</b>	<->	<b>o</b>	<b>-1500/+500 Pa</b>	<b>multi</b>	<b>AA</b>

**For dampers type KAMOUFLAGE 1V DP 120 installed in a duct:**

- in a PROMATECT L500 duct th = 50 mm
- in a GEOFLAM duct th = 45 mm
- in a GEOFLAM LIGHT duct th = 35 mm
- in a GEOTEC S duct th = 45 mm
- in an EXTHAMAT duct th = 35 mm
- in a DESENFIRE HD duct th = 35 mm
- in a DESENFIRE duct th = 45 mm
- in a DESENFIRE STR duct th = 25 mm
- in a TECNIVER L50 duct th = 45 mm
- in a GLASROC F/V500 duct th = 50 mm
- in a GEOFLAM N duct th = 35 mm

E	I	-	t	S	Ved	ho	i	<->	o	Operating pressure	multi	AA
<b>E</b>	<b>I</b>		<b>120</b>	<b>S</b>	<b>Ved</b>	-	<b>i</b>	<->	<b>o</b>	<b>-500/+500 Pa</b>	<b>multi</b>	<b>AA</b>

## **9. DIRECT SCOPE OF APPLICATION OF THE RESULTS**

---

### **9.1. GENERAL**

The requirements relating to the scope of application of all fire-resistant dampers submitted for testing in accordance with EN 1366-10 apply, as well as the following elements.

The direct field of application of EN 1366-2 applies

### **9.2. DIMENSIONS OF SMOKE CONTROL DAMPERS**

Dampers with the following flush-mounted dimensions may be used:

- 300 x 385 to 700 x 1075 mm (l x h) for dampers with one door (KAMOUFLAGE 1V),
- 350 x 385 to 1100 x 1105 mm (l x h) for dampers with two doors (KAMOUFLAGE 2V).

They shall be installed in all duct sizes permitted within the direct field of application stated in EN 1366-8 and EN 1366-9.

They shall only be used in the applications tested and those applications covered in this DIAP.

### **9.3. APPLICATION OF SMOKE CONTROL DAMPERS AT DIFFERENT POSITIONS IN THE DUCTS**

The results given in section 7.2 of this classification report apply only to dampers installed on the vertical face of a horizontal or vertical smoke extraction duct.

### **9.4. PRESSURE DIFFERENCES**

In accordance with standard EN 1366-10 - section 9.3, the performance levels specified in section 7.2 of this classification report are valid for any smoke extraction duct operating with a pressure drop of -1500 or overpressure of +500 Pa.

### **9.5. ELEVATED TEMPERATURES**

The multi-compartment smoke control dampers submitted for test in accordance with the standardised fire test curve in EN 1363-1 are suitable for single-compartment applications for the same period of time.

### **9.6. CYCLING TESTS**

In accordance with standard EN 1366-10 - section 9.5.3, the performances specified in section 7.2 of this classification report that are valid for a smoke control damper that operates only in an emergency, are not applicable to other installations.

### 9.7. ACTIVATION METHOD

Smoke control dampers submitted for testing for automatic activation (AA) systems are not suitable for use in manual activation (MA) systems.

### 9.8. APPLICATION TO DUCT CONSTRUCTIONS OTHER THAN THOSE SUBMITTED TO TEST

Multi- compartment smoke control dampers may be applied to ducts that have been tested to EN 1366-9 and EN 1366-8 as appropriate, with the following restrictions:

- a) multi- compartment smoke control dampers may be applied to ducts constructed from materials of the same or greater density as those tested;
- b) multi- compartment smoke control dampers may be applied to ducts of the same material as those tested with the same or a greater thickness;
- c) application may not be made to ducts where there is a change in the surface protection materials of the duct;
- d) paint surface finish of the ducts and/or dampers shall be as the duct and/or dampers were tested or assessed.

Multi compartment smoke control dampers tested on the surface of the duct may also be used in line with single or multi compartment smoke control duct (i.e. between duct sections), providing that the smoke control damper is independently provided with a duct support (support, drop rod, anchor etc. – as tested for the smoke control duct) within 100 mm of the centre of the smoke control damper blade axis. The damper should not support the duct or vice versa.

*NOTE 1 This does not apply to smoke control dampers tested only in compartment boundaries.*

Duct mounted multi-compartment smoke control dampers tested to this document may be used in association with fire resisting ductwork tested to EN 1366-1. They may also be used in line with fire resisting ductwork (e.g. for flow control and isolation between duct sections), providing that the smoke control damper is independently provided with a duct support (support, drop rod, anchor etc. - as tested for the fire resisting duct) within 100 mm of the centre of the smoke control damper blade axis. The damper should not support the duct or vice versa.

*NOTE 2 This does not apply to smoke control dampers tested only in compartment boundaries.*

Saint-Aubin, November 27<sup>th</sup>, 2025




Project leader  
Signé par : Camille SALSI




Supervisor  
Signé par : Romain STOUVENOT


## ILLUSTRATIONS APPENDIX

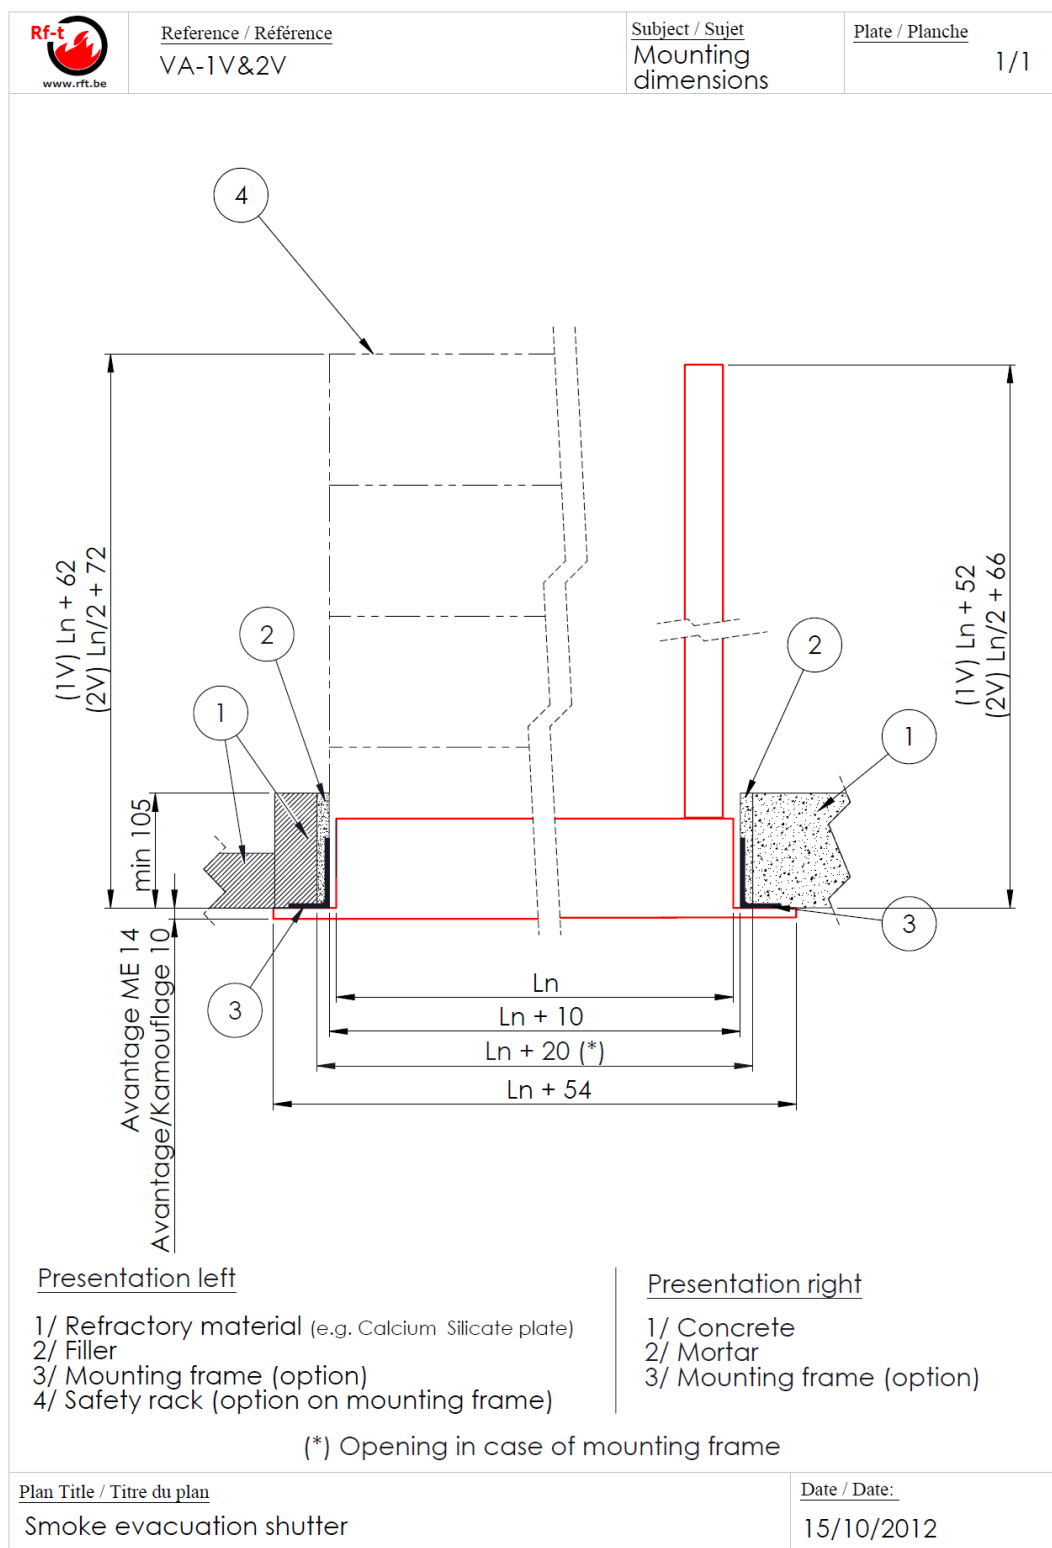

ESTHETIC VERSION (Kamouflage)

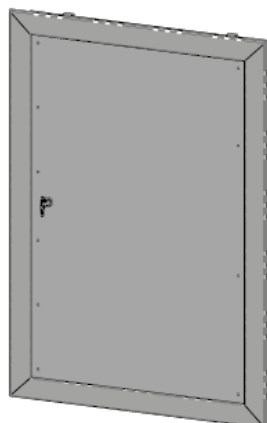


ESTHETIC VERSION (Kamouflage)

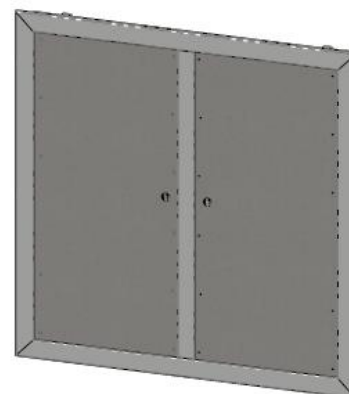

ESTHETIC VERSION +  
OPTION SAFETY BARS  
(Kamouflage + KGD)



ESTHETIC VERSION +  
OPTION SAFETY RACK  
(Kamouflage + KGC)

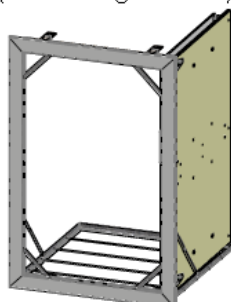

ESTHETIC VERSION +  
OPTION SAFETY BARS  
(Kamouflage + KGD)



ESTHETIC VERSION +  
OPTION SAFETY RACK  
(Kamouflage + KGC)






Reference - Subject - Date

1V-2V Mounting frame - EASY-KAP 27-08-2019

Plate

B 1/2

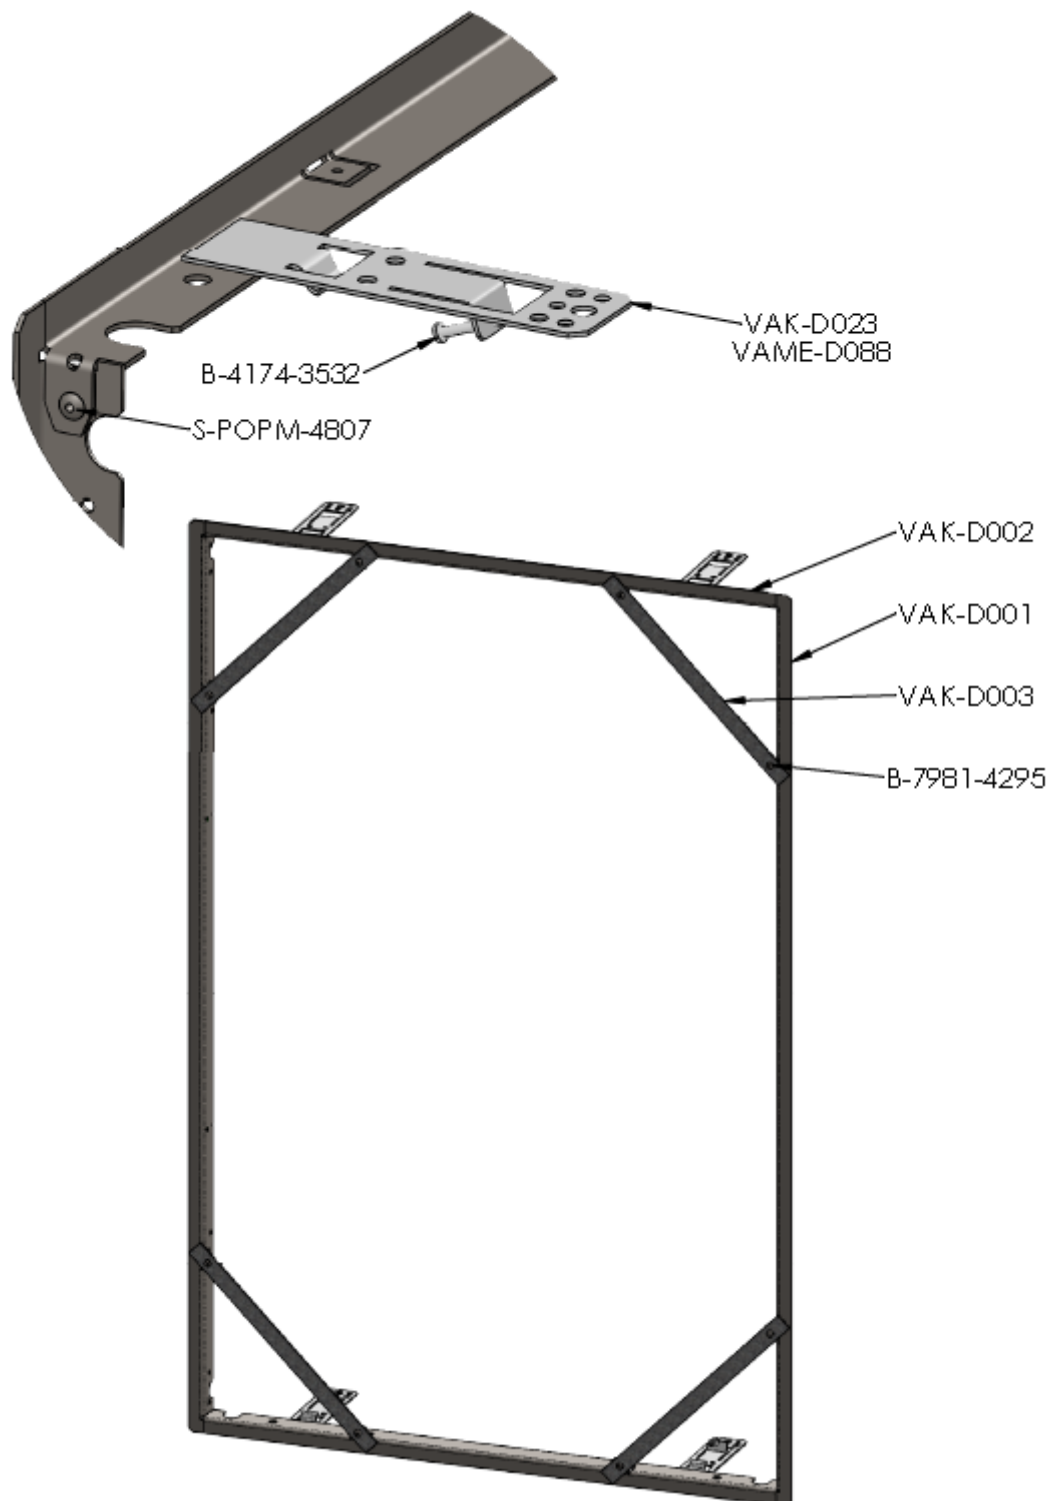



Reference - Subject - Date

1 V-2V Mounting frame with safety rack - EASY-KGC 27-08-2019

Plate

B 1/3


All used rivets are S-POPM-4807

$W_n \leq 700$




Only for Kamouflage

$W_n > 700$

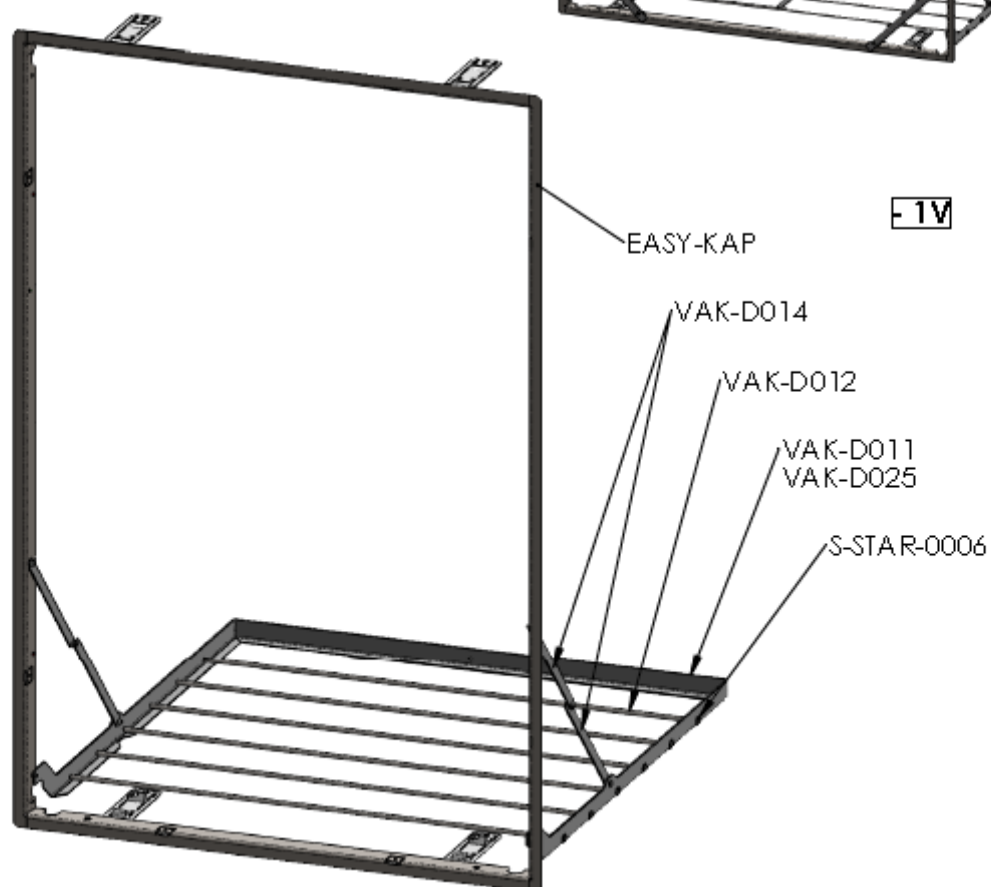



	<p>Reference - Subject - Date</p> <p>1V-2V Mounting frame with safety rack - EASY-KG C 27-08-2019</p>	<p>Plate</p> <p>B 2/3</p>
---	---	---------------------------

